

Please read and follow these few simple guidelines for the storage of your Calor gas cylinders to ensure the Health and Safety of yourself and others who may be affected.

### LPG – General Cylinder Users

Up to 15 kg of Butane in not more than 2 cylinders (blue) may be used indoors in residential premises, (e.g. mobile heaters), and a further maximum of up to 15kg in not more than 2 spare cylinder(s) may also be stored indoors.

Propane cylinders (red) may be used indoors in commercial and industrial premises only on a temporary basis, i.e. blowtorch, blown air heater, but the cylinders must always be stored outdoors.


### Basic Rules

- Cylinders should be used and stored in the upright position
- Cylinders should be stored in well ventilated places away from sources of heat, ignition sources and readily ignitable materials.
- Cylinders must not be stored or used below ground level or in high rise flats where gas is prohibited.
- Cylinders should be preferably be stored outdoors, away from buildings entry/exit points and features such as drains.
- Cylinders must not be kept near to any corrosive, toxic or oxidant material

### LPG at Fixed Installation

#### LPG at Fixed Installations.


- In the case of fixed installations, propane cylinders must be sited outside

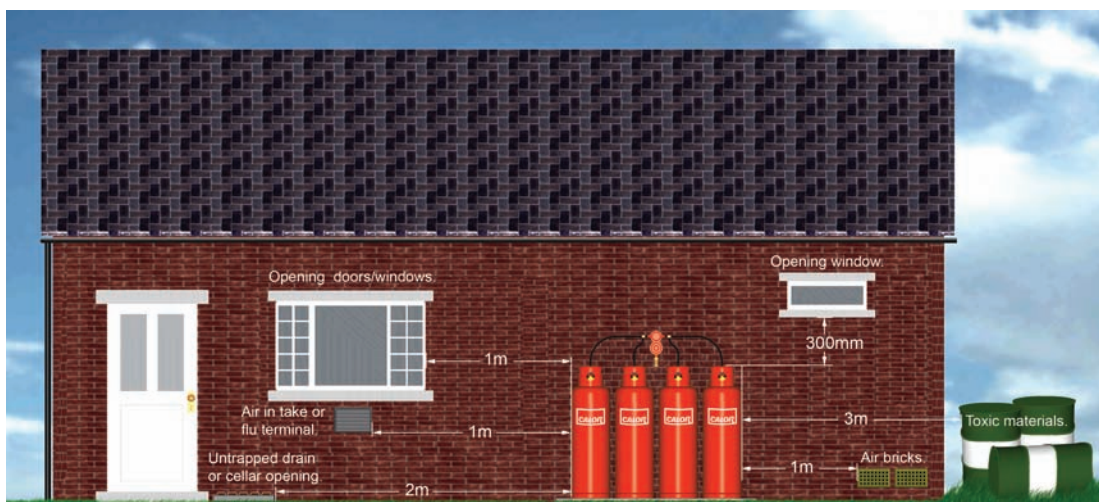

### LPG Storage at Dealers, Stockists, Commercial & Industrial Premises

LPG cylinders should be stored in accordance with UKLPG Code of Practice No. 7 "Storage of Full and Empty LPG Cylinders and Cartridges". Separation distances vary dependant on the quantities of LPG being stored, however, the main requirements are as follows:-

- The use of a purpose built compound or cage is recommended
- Full and empty cylinders should be segregated
- LPG cylinders should be segregated from flammable liquids, combustible, oxidising, corrosive, toxic materials & compressed gas cylinders
- For storage of up to 400kg cylinders at Stockist premises, Calor may be able to supply a cylinder storage cage.

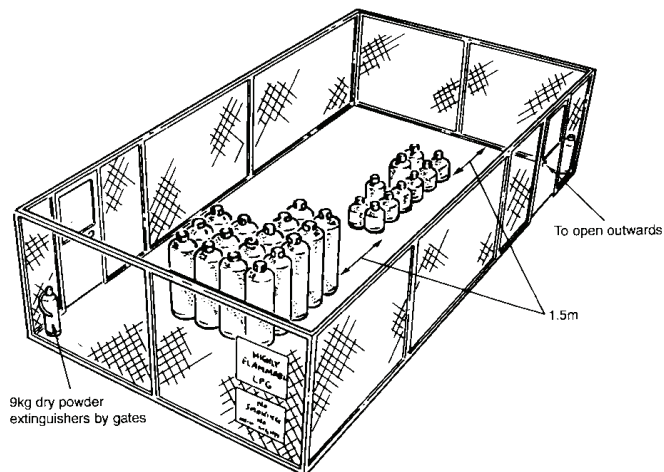

### Basic Procedure in Case of Fire

Anyone who discovers a fire should call the Fire Brigade and tell them that LPG cylinders may be involved.

- In any emergency situation, it is of paramount importance to avoid endangering human life.
- Always approach a fire or leak from upwind. Do not attempt to extinguish a flame unless it is safe to do so.
- Keep all persons, except those necessary to deal with the emergency, at least 60 metres away from the danger area.

### Leaking of LPG without Fire

An attempt should be made to stop the leak by closing the valve where possible and replacing the plug or cap.

If the leak cannot be stopped, the cylinder should be carefully removed to a well-ventilated open space clear of drains, buildings and sources of ignition. It should be marked faulty and left with the leak (usually at the valve) uppermost. General access should be prevented e.g. by temporary barriers. The supplier of the cylinder should be informed immediately.

**In no circumstances should retailers attempt to dismantle or repair defective cylinder valves.**



# Technical Publication

## Cylinder Storage Information

### First Aid Information

**Eyes:** Immediately flush eyes with plenty of cool water for at least 15 minutes. Hold eyelids apart while flushing to rinse entire surface of eye and lids with water. Get immediate medical attention.

**Skin:** In case of cold burns, immediately place effected area in tepid water and keep immersed until circulation returns.

**Ingested:** No emergency care anticipated, the material is a gas at standard temperature and pressure.

**Inhalation:** Immediately remove patient to uncontaminated area. Keep warm and at rest. If breathing has stopped or shows signs of failing, commence artificial respiration. Summon immediate medical attention.

**Other Requirements:** Severe inhalation, over exposure to this product may sensitise the heart to catecholamine induced arrhythmias. Do not administer catecholamines to an over exposed person.

### Additional Information

Further details and guidance may be found in the following UKLPG Codes of Practice: -

- No. 7 Storage of Full and Empty LPG Cylinders and Cartridges
- No. 24 Part 1 Use of Propane in Cylinders at Residential Premises
- No. 24 Part 2 Use of Butane in Cylinders at Residential Premises
- No. 24 Part 5 The Storage and Use of LPG on Construction Sites

A full list of publications is available on [www.uklpg.org](http://www.uklpg.org)

Calor Gas Technical Publications

- 104368 – Cylinder Cage Instructions for use
- 104796 – Code of Guidance for the Storage of Full & Empty Cylinders

**If you require further advice please contact the Technical Help Desk at Tachbrook Park (01926 318497)**

**CALOR GAS EMERGENCY SERVICE – 0845 7 444999  
(ALL CALLS CHARGED AT LOCAL RATE)**

The information in this document is intended to give guidance and believed to be accurate and represent good practice at the time of publication. It does not replace the need to consult other formal documents where further information may be required.

No responsibility or liability is accepted by Calor Gas Limited for any loss or damage arising out of the information given. It is important that users of this publication adhere to all legal requirements, Regulations, CoP's and Standards, particularly, those relating to gas safety.

All rights reserved. No part of this publication may be reproduced, stored in a retrieval system or transmitted in any form, or by any means, electronic, electrostatic, magnetic tape, mechanical, photocopying, recording, or otherwise, without permission in writing from Calor Gas Ltd.